




1 DETAIL – TYPICAL DUPLEX RECEPTACLE INSTALLATION
E5.1 NOT TO SCALE

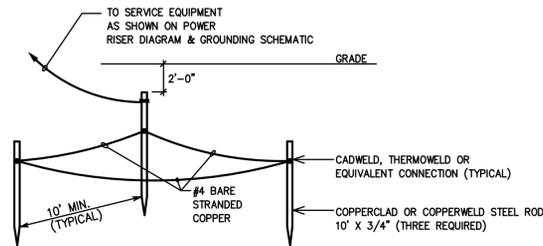


4 TYPICAL MADE GROUNDING ELECTRODE
E5.1 NOT TO SCALE

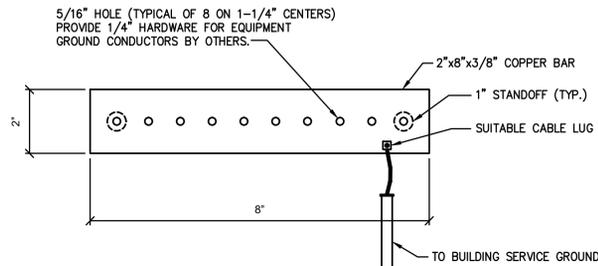


7 DETAIL – GROUND BAR FOR TELE/DATA ROOM
E5.1 NOT TO SCALE

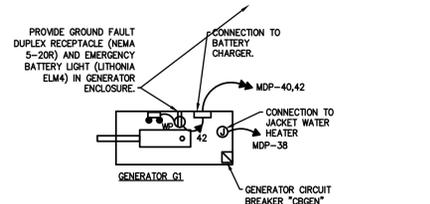


8 EMERGENCY GENERATOR DETAIL
E5.1 NOT TO SCALE

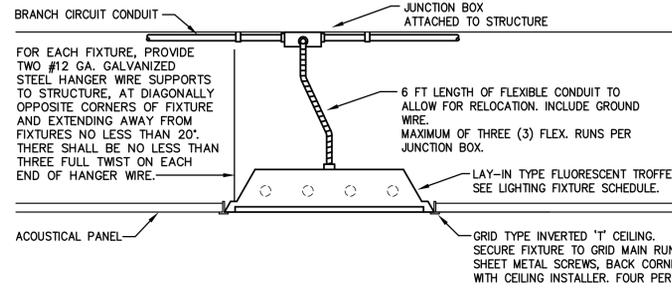

2 DETAIL – TYPICAL LAY-IN FIXTURE INSTALLATION
E5.1 NOT TO SCALE

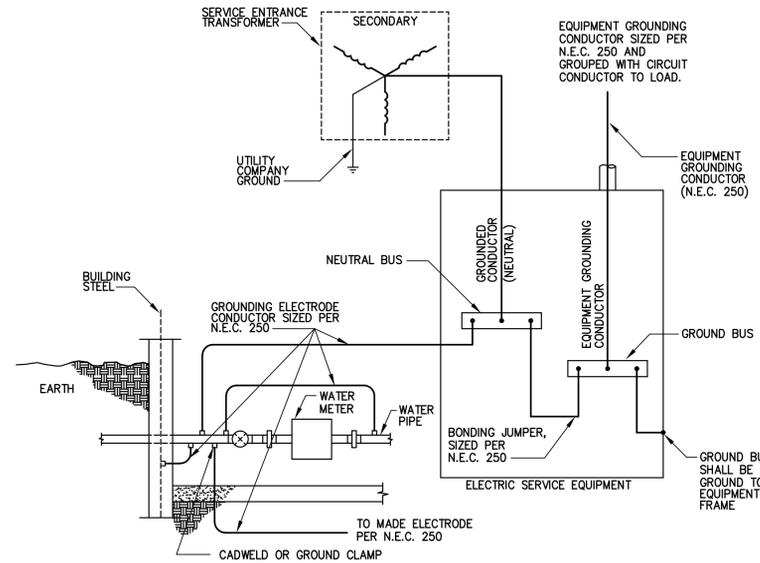


5 GROUNDING CONNECTION DIAGRAM
E5.1 NOT TO SCALE

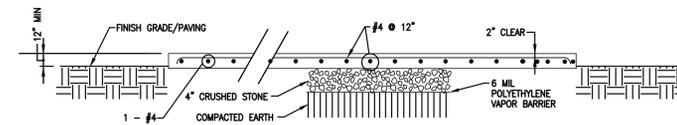


9 SECTION – GENERATOR PAD
E5.1 NOT TO SCALE

SPECIAL NOTES:
 ◆ EXACT PAD SIZE AND THICKNESS SHALL BE AS REQUIRED FOR GENERATOR. PAD TO EXTEND 6" BEYOND GENERATOR ON ALL SIDES. COORDINATE EXACT DIMENSIONS WITH EQUIPMENT AND OWNER.

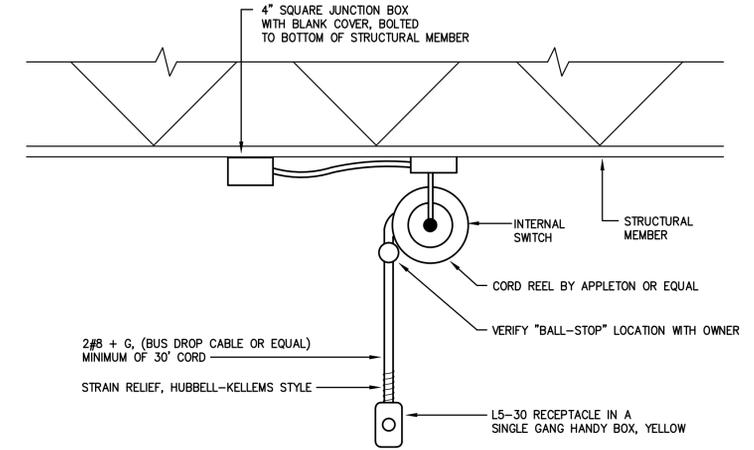


3 120V 30A CORD REEL DETAIL
E5.1 NOT TO SCALE

NOTE:
 LIMIT TRAVEL OF CORD SO THAT FIXTURE & RECEPTACLE CANNOT BE PULLED LOWER THAN 24" AFF.

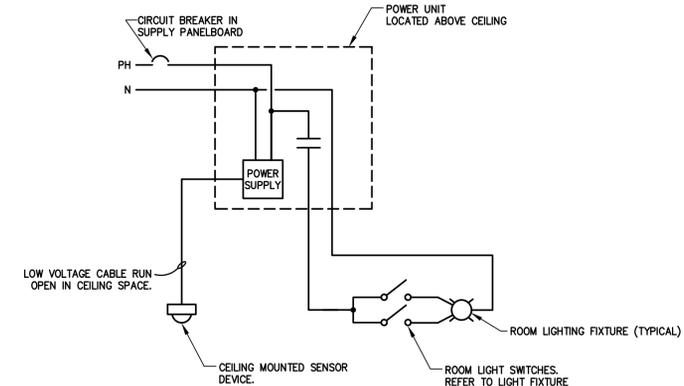

6 DETAIL – OCCUPANCY SENSOR CONTROL
E5.1 NOT TO SCALE

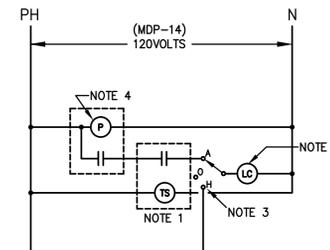

MDP-14 — EXTERIOR LIGHTING
 — SPARE
 — SPARE
 — SPARE

10 EXTERIOR LIGHTING CONTROL DIAGRAM-ELC1
E5.1 NO SCALE

